



• BAUSTOFFPRÜFSTELLE Wismar GmbH • LÜBSCHER STRASSE 109 • 23966 WISMAR •

Mactac Europe
Philippe Vanroy
Bd Kennedy Z.I. Zone B
7060 Soignies
BELGIUM

Wismar, 13.10.2016
18.10.2016(V)

our signatur: Ha./Vo.

Test report no.:	2032/16-V
Customer:	MACTAC EUROPE
Subject matter:	Testing accordance - Determination of the anti-slip property - Workrooms and fields of activities with slip danger, walking method - Ramp test according to DIN 51130:2014-02
Subject date:	11.10.2016
Samples received:	12.10.2016
test date:	13.10.2016
Name of the product:	LUV6301 self-adhesive foil Dimensions l/w [cm]: 340 x 137
Number of samples:	1 role
Origin:	as customer
Sampling:	The samples were provided by the customer.

The test report comprises 2 pages

The test results related exclusively to the subject matter that was tested. The test report may not be copied, passed on to third parties or published in extracts without the written consent of BPS Wismar.

Determination of the anti-slip property according to DIN 51130:2014-02 "Testing of floor coverings - Determination of the anti-slip property - Workrooms and fields of activities with slip danger, walking method - Ramp test

Description of the panel:

The transparently colorless foil has a level surface.

Preparation of the test cover:

A test cover, size 100 x 50 cm was produced by laying on a self-supporting, non-warping panel.

The width of a joint amounted to 0 mm.


The cover was cleaned with a dry cloth before the start of the test.

Mean angle of inclination:


Test no.	Corrected overall angle of acceptance DIN 51 130 increased skid risk [°]
1	6,6
2	6,8
3	6,5
4	6,3
5	6,6
6	6,8
Mean value	6,6
Mean angle of inclination for assessment group shown below:	6 - 10

Assessment group:

In accordance with the test results obtained pursuant to the guidelines of DIN 51130; the tiles are to be classified in assessment group **R 9**.


Dipl.-Ing.(FH) Ch. Hartig
Official in Charge

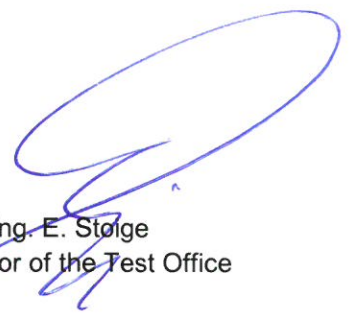


Dipl.-Ing. E. Stöge
Director of the Test Office